



This report complies with the accreditation requirements of Cgcre/Inmetro, the Brazilian national institute for industrial quality that evaluated the laboratory performance.



Test Report PD.33.GS.E1A.3313A/RE-08-AA

Electromagnetic Compatibility Tests on Arc Sensor with Cable Communication

Model: ZSA/90/24/UVA

Manufacturer: Varixx

Quotation: 28808/11 SO: 64746

Customer: Varixx Indústria Eletrônica Ltda
Contact: Leonardo Lopes
Address: Rua Phellippe Zaidan Maluf, 450
13422-190 - Piracicaba/SP-Brazil

Email: leonardo@varixx.com.br

Phone: +55 19 3301-6900

Fax: +55 19 3424-4001

Table of Contents

1	Scope.....	4
2	Identification of Equipment Under Test.....	4
2.1	Changes made to the sample during tests.....	6
3	General Information.....	6
4	Technical Documentation Provided.....	6
5	Test Methods and References.....	7
6	Test Laboratory.....	7
7	Summary of the Tests Performed.....	8
8	Terminology.....	8
9	EUT Operating Conditions.....	9
10	Radiated Emission.....	10
10.1	Instruments Used.....	10
10.2	Test Procedure.....	10
10.3	Environmental Conditions.....	10
10.4	Results.....	11
10.4.1	Measurement Uncertainty.....	12
10.5	Photos of the Test Assembly.....	13
11	Radiated Disturbance Immunity.....	13
11.1	Instruments Used.....	13
11.2	Test Procedure.....	14
11.3	Environmental Conditions.....	14
11.4	Results.....	14
11.5	Photos of the Test Assembly.....	15
12	Immunity to Conducted RF Disturbances in Telecommunications and Electric Power Terminals	15
12.1	Instruments Used.....	15
12.2	Test Procedure.....	16
12.3	Environmental Conditions.....	16
12.4	Results.....	16
12.5	Photos of the Test Assembly.....	17
13	Immunity to Electrical Fast Transient/Burst in Telecommunications and Electric Power Terminals.....	17

Not valid as a compliance certificate.
This report can only be reproduced in its entirety.

13.1	Instruments Used.....	17
13.2	Test Procedure.....	17
13.3	Environmental Conditions.....	17
13.4	Results.....	18
13.5	Photos of the Test Assembly.....	18
14	Immunity to Electrostatic Discharges.....	18
14.1	Instruments Used.....	18
14.2	Test Procedure.....	19
14.3	Environmental Conditions.....	19
14.4	Results.....	19
15	Surge Immunity in Electric Power Terminals.....	21
15.1	Instruments Used.....	21
15.2	Test Procedure.....	21
15.3	Environmental Conditions.....	21
15.4	Results.....	21
15.5	Photos of the Test Assembly.....	22
16	Immunity to Magnetic Fields.....	22
16.1	Instruments Used.....	22
16.2	Test Procedure.....	22
16.3	Environmental Conditions.....	23
16.4	Results	23
16.5	Photos of the Test Assembly.....	23
17	Immunity Test Measurement Uncertainty.....	24
18	Comments.....	24
19	Document Issues.....	24
20	Execution and Approval	24

Not valid as a compliance certificate.
This report can only be reproduced in its entirety.

1 Scope

The objective of this report is to present electromagnetic compatibility tests on the equipment identified in Item 2, based on the regulations presented in Section 5 of this report.

2 Identification of Equipment Under Test

The equipment is showed in photos 1 to 11:



Photos 1 and 2 Equipment Under Test (EUT) – Sample 5284



Photos 3 and 4 Equipment Under Test (EUT) – Sample 5284

Not valid as a compliance certificate.
This report can only be reproduced in its entirety.




Photos 5 and 6 Equipment Under Test (EUT) – Sample 5284



Photos 7 and 8 Equipment Under Test (EUT) – Sample 5284

Not valid as a compliance certificate.
This report can only be reproduced in its entirety.

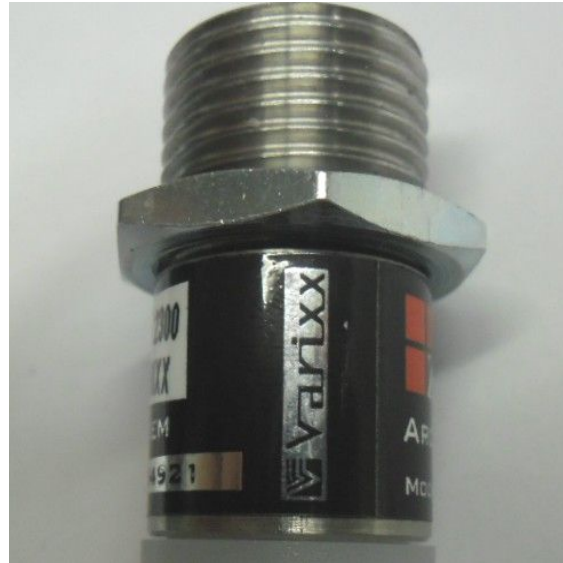

Photos 9 and 10 Equipment Under Test (EUT) – Sample 5284



Photo 11 Equipment Under Test (EUT) – Sample 5284

2.1 Changes made to the sample during tests

No changes were made to the samples under test.

3 General Information

Received on	Samples	Tests start date	Tests end date
03/Nov/11	5284	07/Nov/11	10/Nov/11

4 Technical Documentation Provided

No technical documentation was provided.

Not valid as a compliance certificate.
This report can only be reproduced in its entirety.

5 Test Methods and References

- a) CISPR 11 (2010 – Ed. 5.1) – Industrial, scientific and medical equipment – Radio-Frequency disturbance characteristics – Limits and methods of measurement.
- b) IEC 61000-4-2 (2001) – Electromagnetic Compatibility (EMC) – Part 4: Testing and Measurement Techniques. Section 2: Electrostatic discharge immunity test.
- c) IEC 61000-4-3 (2008) – Electromagnetic Compatibility (EMC) – Part 4: Testing and Measurement Techniques. Section 3: Radiated electromagnetic field requirements.
- d) IEC 61000-4-4 (2004) – Electromagnetic Compatibility (EMC) – Part 4: Testing and Measurement Techniques. Section 4: Electrical fast transient.
- e) IEC 61000-4-5 (2005) – Electromagnetic Compatibility (EMC) – Part 4: Test and Measurement Techniques. Section 5: Surge immunity test.
- f) IEC 61000-4-6 (2006) – Electromagnetic Compatibility (EMC) – Part 4: Testing and Measurement Techniques. Section 6: Immunity to conducted disturbances induced by radio-frequency fields.
- g) IEC 61000-4-8 (2001) – Electromagnetic Compatibility (EMC) – Part 4: Testing and Measurement Techniques. Section 8: Power frequency magnetic field immunity test.

6 Test Laboratory

CPqD – Centro de Pesquisa e Desenvolvimento em Telecomunicações

Rod. Campinas-Mogi-Mirim, km 118,5 – SP340 PO Box 6070

13086-902 – Campinas – SP – Brazil

Laboratory and Network Infrastructure Corporate Department

Network Infrastructure Solutions Department

Electromagnetic Compatibility Area

Victor Vellano Neto

email: vellano@cpqd.com.br

Phone: + 55 (19) 3705-7097

Fax: + 55 (19) 3705-6699

Not valid as a compliance certificate.
This report can only be reproduced in its entirety.

7 Summary of the Tests Performed

Test	Reference document	Specification	Configuration	Sample
Radiated Emission	CISPR 11 (2010)	Group 1 Class A	Default	Sample 5284
Radiated Disturbance Immunity	IEC 61000-4-3 (2008)	10 V/m, from 80 MHz to 3 GHz	Default	Sample 5284
Immunity to Conducted RF Disturbances in Telecommunications and Electric Power Terminals	IEC 61000-4-6 (2006)	10 V from 150 kHz to 80 MHz	Default	Sample 5284
Immunity to Electrical Fast Transient/Burst in Telecommunications and Electric Power Terminals	IEC 61000-4-4 (2004)	Telecommunications: 2 kV Electric Power: 2 kV	Default	Sample 5284
Immunity to Electrostatic Discharges	IEC 61000-4-2 (2001)	6 kV for contact discharge 8 kV for air discharge	Default	Sample 5284
Surge Immunity in Electric Power Terminals	IEC 61000-4-5 (2005)	Electric Power a.c.: 1 kV line-to-line 2 kV line-to-ground	Default	Sample 5284
Immunity to Magnetic Fields	IEC 61000-4-8 (2001)	Severity 4	Default	Sample 5284

8 Terminology

The following terms and definitions are used in this document:

AE – Auxiliary Equipment

EUT – Equipment Under Test

LISN – Line Impedance Stabilization Network

EMC – Electromagnetic Compatibility

EMI – Electromagnetic Interference

ESD – Electrostatic Discharge

DC – Direct Current

Not valid as a compliance certificate.
This report can only be reproduced in its entirety.

9 EUT Operating Conditions

During the tests, the equipment was set up in typical conditions, this procedure is the responsibility of the manufacturer:

Configuration (default)

Tests were run on equipment under typical use conditions. The Source Relay VPS12024 and ZSA model tester (arc generator) were used to constantly monitor the correct operation.

Figure 1 illustrates the configuration.

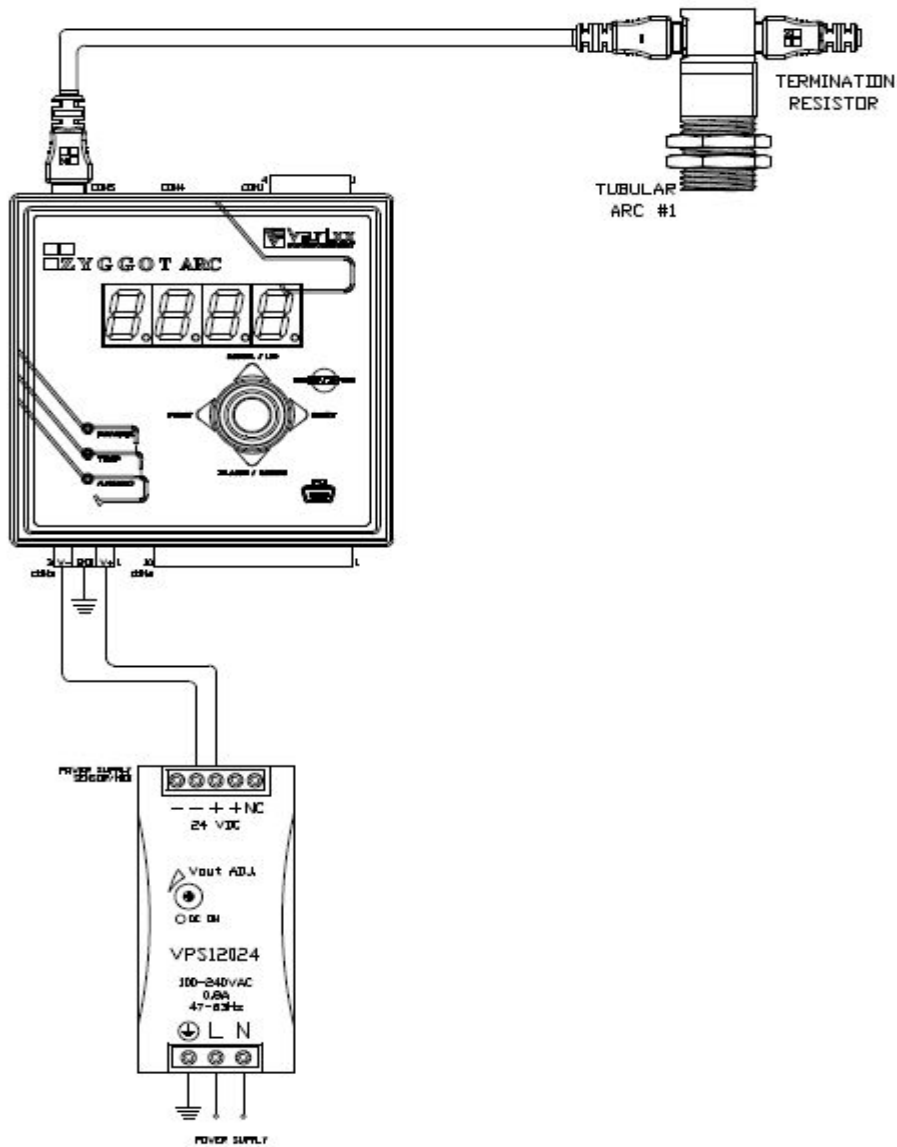


Figure 1 Configuration (default)

Not valid as a compliance certificate.
This report can only be reproduced in its entirety.

Table 1 List of auxiliary equipment used with the EUT operation

Equipment	Manufacturer	Model	Identification	Owner	Validity of calibration/verification – Traceability
Source	Varixx	VPS 12024	S/N VMT54895	Varixx	Calibration not required
Relay	Varixx	VZA/B1	S/N 58846	Varixx	Calibration not required

10 Radiated Emission

10.1 Instruments Used

Table 2 List of equipment used in the Radiated Emission Test

Equipment	Manufacturer	Model	Identification	Validity of calibration/verification – Traceability
SEMI-ANECHOIC CHAMBER	ETS	3m	CSA pr-12	Site Attenuation: July 2014 – CPQD
EMI TEST RECEIVER	R&S	ESI26	S/N 835336/007	December 2011 – CPQD
RELAY SWITCH UNIT	R&S	331.1601.31	S/N 338969/001	Calibration not required
MULTI-DEVICE CONTROLLER	ETS	2090	S/N 0005-1517	Calibration not required
MICROCOMPUTER	COMPAQ	PENTIUM III	—	Calibration not required
ELECTRIC TURNTABLE SYSTEM	ETS	2087	—	Calibration not required
MINI MAST	ETS	2075	—	Calibration not required
BICONILOG ANTENNA	ETS	3142B	RCE000854	February 2012 – ETS

10.2 Test Procedure

Measurement procedures comply with the CISPR11 standard. Quasi-peak values for radiated field were used as reference. The product was classified as a Class A / Group 1 equipment. EUT assembly and operation followed the procedures established in CISPR11 as described in Section 9.

10.3 Environmental Conditions

All tests were performed in a controlled environment as specified in the documents listed in Section 5.

Not valid as a compliance certificate.
This report can only be reproduced in its entirety.


Temperature	Initial: 22.8 °C	Relative air humidity	Initial: 51.7 %
	Final: 22.4 °C		Final: 51.2 %

10.4 Results

Note: Changes in the sample, if applicable, will be described in Section 2.1. Changes are designated by the sample number followed by the word “modified” and a number (in sequence). The customer is responsible for all changes.

Table 3 Radiated Emission Test Results


Graph 1 – Radiated Emission Test Results – Default Configuration – Power Supply 220V @ 60 Hz – Sample 5284
Quasi-Peak Values
No significant values

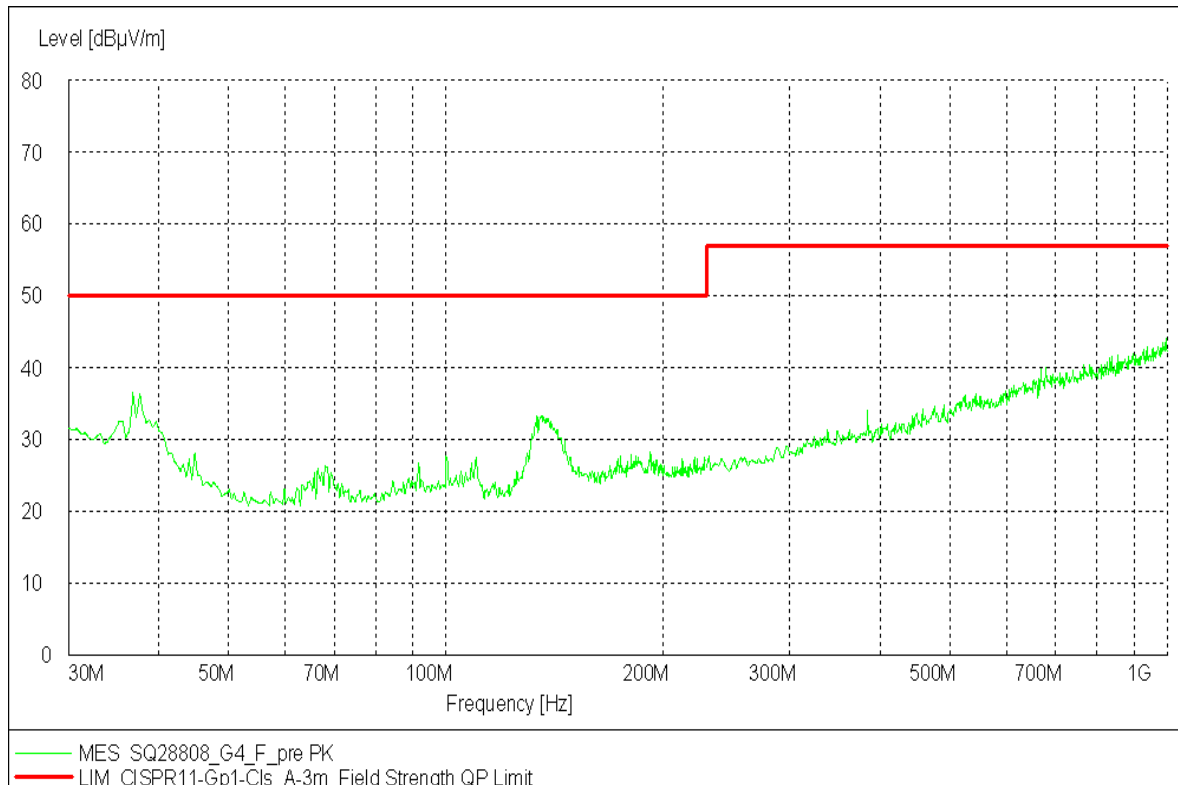

Graph 1 Radiated Emission Test Results – Default Configuration – Power Supply 220V @ 60 Hz (24 Vdc output) – Sample 5284

Note: Preliminary tests were run using the product power supply and a complete test was conducted at the higher emission level. Graph 2 shows the preview.

Not valid as a compliance certificate.
This report can only be reproduced in its entirety.

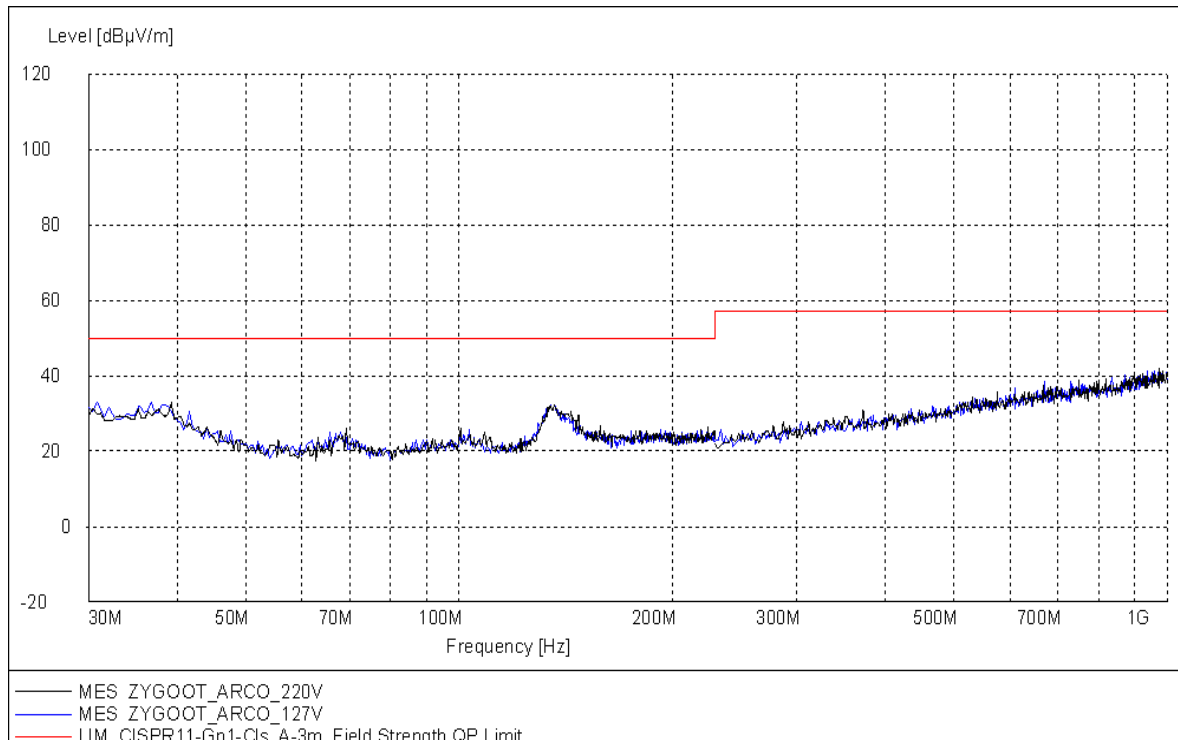

Graph 2 Radiated Emission Preliminary Test Results – Default Configuration – Power Supply 127V @ 60 Hz / 220V @ 60 Hz – Sample 5284

10.4.1 Measurement Uncertainty


The following table shows the strength measurement uncertainty values of the electromagnetic field.

Test	Quantity	Uncertainty	k	Confidence level
Radiated Emission	Electric field strength	±4.460 dB	2	95%

According to Section 12.5 of CISPR11 (Edition 5.1 – 2010), assessment of compliance with the standard will be based on the measurement results, without taking into account uncertainties.

Not valid as a compliance certificate.
 This report can only be reproduced in its entirety.

10.5 Photos of the Test Assembly

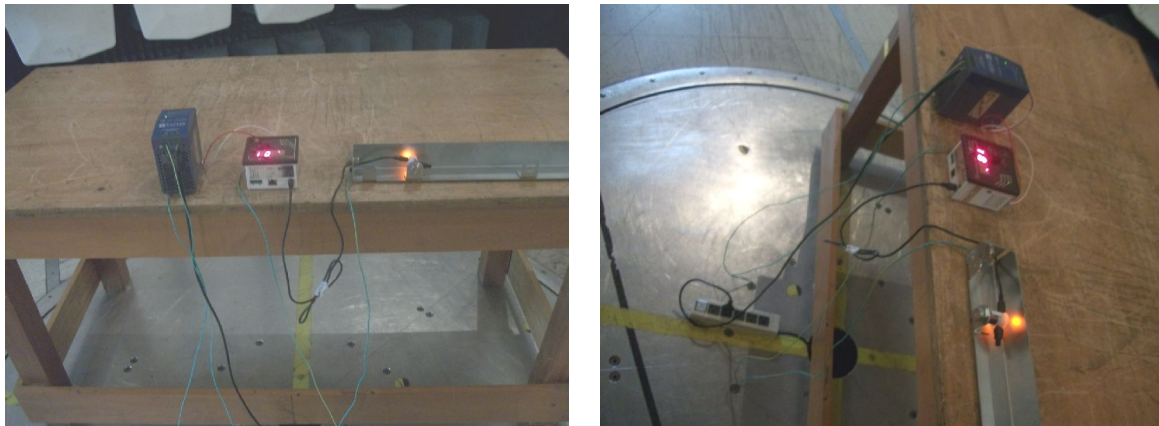

Photos 12 and 13 - Radiated emission

11 Radiated Disturbance Immunity

11.1 Instruments Used

Table 4 List of equipment used in the Radiated Disturbance Immunity Test

Equipment	Manufacturer	Model	Identification	Validity of calibration/verification – Traceability
SEMI-ANECHOIC CHAMBER	ETS	SpaceSaver 26H – Part Number ETS SS26H	CSA pr-T3	Field uniformity adjustment: April 2012 – CPqD
SIGNAL GENERATOR	R&S	SMB100A	S/N 1406.6000.02	April 2014 – PD.SM.11.22A.2286A/CC-03-AA
USB ADAPTER FOR NRP-Z	R&S	NRP-Z4	S/N 1146.8001.02	N/A
AVERAGE POWER SENSOR	R&S	NRP-Z91	CPqD036865	April 2013 – PD.SM.11.22A.2285A/CC-03-AA
OPEN SWITCH AND CONTROL PLATFORM OSP	R&S	OSP 120	1505300902	N/A
AMPLIFIER 80 MHZ – 1GHz	Bonn	BLW0810-250/100	087036B	N/A
DUAL AMPLIFIER 0.8 – 2.5 GHz / 2.5 – 6 GHz	Bonn	BLW0860-75/50D	087098	N/A
ULTRALOG ANTENNA	R&S	HL562	100425	N/A

Not valid as a compliance certificate.
This report can only be reproduced in its entirety.

Equipment	Manufacturer	Model	Identification	Validity of calibration/verification – Traceability
BROADBAND HORN ANTENNA	SB	BBHA9120E	387	N/A
STACKED LOG-PER ANTENNA	SB	STLP9149	24	N/A
SYSTEM SOFTWARE	R&S	EMC32-S	N/A	N/A
DELL PC	DELL	Optiplex 755	CPqD03570407	N/A
19 INCH RACK	R&S	TS-SEMS	N/A	N/A
TRIPOD	R&S	HL562Z1	100157	N/A

11.2 Test Procedure

Procedures comply with the IEC 61000-4-3 standard, with a 10 V/m severity level range varying from 80 MHz to 1 GHz and from 1 GHz to 3 GHz.

11.3 Environmental Conditions

All tests were performed in a controlled environment as specified in the documents listed in Section 5.

Temperature	Initial: 19.8 °C	Relative air humidity	Initial: 48.3 %
	Final: 19.5 °C		Final: 50.3 %

11.4 Results

Note: Changes in the sample, if applicable, will be described in Section 2.1. Changes are designated by the sample number followed by the word “modified” and a number (in sequence). The customer is responsible for all changes.


Table 5 Radiated Disturbance Immunity Test Results

<i>Default Configuration – Sample 5284</i>			
<i>Frequency Range: 80 MHz to 1 GHz</i>			
<i>Vertical Polarization</i>		<i>Horizontal Polarization</i>	
<i>EUT side</i>	<i>Note</i>	<i>EUT side</i>	<i>Note</i>
Front side (LVF)	Nothing on record	Front side (LVF)	Nothing on record
<i>Frequency Range: 1 GHz to 3GHz</i>			
<i>Vertical Polarization</i>		<i>Horizontal Polarization</i>	
<i>EUT side</i>	<i>Note</i>	<i>EUT side</i>	<i>Note</i>
Front side (HVF)	Nothing on record	Front side (HVF)	Nothing on record

Based on the performance criteria established in the IEC 61000-4-3 standard, the EUT performance was monitored while applying the disturbance and no difference was detected when comparing both with and without disturbance operation modes.

Not valid as a compliance certificate.
This report can only be reproduced in its entirety.

11.5 Photos of the Test Assembly

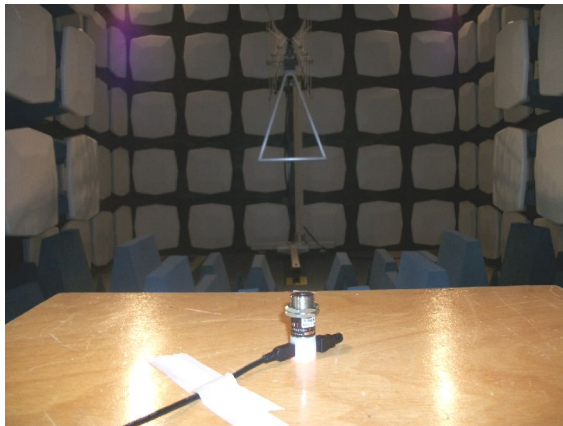

Photos 14 and 15 - Radiated Disturbance Immunity

12 Immunity to Conducted RF Disturbances in Telecommunications and Electric Power Terminals

12.1 Instruments Used

Table 6 List of equipment used in the Immunity to Conducted RF Test

Equipment	Manufacturer	Model	Identification	Validity of calibration/verification – Traceability
SEMI-ANECHOIC CHAMBER	ETS	SpaceSaver 26H – Part Number ETS SS26H	CSA pr-T3	N/A
SIGNAL GENERATOR	R&S	SMB100A	S/N 1406.6000.02	April 2014 – PD.SM.11.22A.2286A/CC-03-AA
USB ADAPTER FOR NRP-Z	R&S	NRP-Z4	S/N 1146.8001.02	N/A
AVERAGE POWER SENSOR	R&S	NRP-Z91	CPqD036865	April 2013 – PD.SM.11.22A.2285A/CC-03-AA
OPEN SWITCH AND CONTROL PLATFORM OSP	R&S	OSP 120	1505300902	N/A
AMPLIFIER	AMPLIFIER RESEARCH	150A100B	CPqD 035440	Not required
SYSTEM SOFTWARE	R&S	EMC32-S	N/A	N/A

Not valid as a compliance certificate.
This report can only be reproduced in its entirety.

Equipment	Manufacturer	Model	Identification	Validity of calibration/verification – Traceability
DELL PC	DELL	Optiplex 755	CPqD03570407	N/A
19 INCH RACK	R&S	TS-SEMS	N/A	N/A
6 dB ATTENUATOR 6 dB - DC of 2 GHz / 100 W 50 Ohms	ROHDE&SCHWARZ	RBU100 1073.8495.06	RCE000984	April 2012 – CPqD
20 dB ATTENUATOR	JFW	766-2050FHC-020-20 20DB	SN2687A (RCE000850)	June 2012 – CPqD
CDN	EM TEST	M2/M3	SN0708-38	Voltage adjustment: July 2012 – CPqD
EMCLAMP	LUTHI	EM101	CPqD 008514	Voltage adjustment: February 2012 – CPqD

12.2 Test Procedure

Procedures comply with the IEC 61000-4-6 standard, with a 10 V severity level range varying from 0.15 MHz to 80 MHz.

12.3 Environmental Conditions

All tests were performed in a controlled environment as specified in the documents listed in Section 5.

Temperature	Initial: 19.5 °C	Relative air humidity	Initial: 50.3 %
	Final: 19.1 °C		Final: 51.1 %

12.4 Results

Note: Changes in the sample, if applicable, will be described in Section 2.1. Changes are designated by the sample number followed by the word “modified” and a number (in sequence). The customer is responsible for all changes.

Table 7 Immunity to Conducted RF Test Results

Coupling	Sample 5284 Configuration/Interface	Note
CDN M2/M3	Default / Power Supply	Nothing on record
EMCLAMP EM101	Default / Communication	Nothing on record

Based on the performance criteria established in the IEC 61000-4-6 standard, the EUT performance was monitored while applying the disturbance and no difference was detected when comparing both with and without disturbance operation modes.

Not valid as a compliance certificate.
This report can only be reproduced in its entirety.

12.5 Photos of the Test Assembly



Photos 16 and 17 - Immunity to Conducted RF

13 Immunity to Electrical Fast Transient/Burst in Telecommunications and Electric Power Terminals

13.1 Instruments Used

Table 8 List of equipment used in the Immunity to Electrical Fast Transients/Burst Test

Equipment	Manufacturer	Model	Identification	Validity of calibration/verification – Traceability
SHIELDED CHAMBER	CPqD	—	CB pr-12	Calibration not required
TRANSIENTS GENERATOR	EM TEST	UCS 500 M4	CPqD 035569	October 2012 – CPqD
CAPACITIVE CLAMP	EM TEST	—	s/n 304613	Calibration not required

13.2 Test Procedure

Procedures comply with the IEC 61000-4-4 standard, with 2 kV severity level for electric power terminals and 2 kV for telecommunications terminals.

13.3 Environmental Conditions

All tests were performed in a controlled environment as specified in the documents listed in Section 5.

Temperature	Initial: 25.1 °C	Relative air humidity	Initial: 51.3 %
	Final: 25.3 °C		Final: 51.4 %

Not valid as a compliance certificate.
This report can only be reproduced in its entirety.

13.4 Results

Note: Changes in the sample, if applicable, will be described in Section 2.1. Changes are designated by the sample number followed by the word “modified” and a number (in sequence). The customer is responsible for all changes.

Table 9 Immunity to Electrical Fast Transient/Burst Test Results

<i>Coupling</i>	<i>Sample 5284 Configuration / Cable</i>	<i>Note</i>
L+N @ ± 2 kV / 5 kHz	Default / Power Supply	Nothing on record
CCP @ ± 2 kV / 5 kHz	Default / Communication	Nothing on record

Notes:
CCP = Capacitive Coupling Clamp.

Based on the performance criteria established in the IEC 61000-4-4 standard, the EUT performance was monitored while applying the disturbance and no difference was detected when comparing both with and without disturbance operation modes.

13.5 Photos of the Test Assembly



Photos 18 and 19 Immunity to Electrical Fast Transient/Burst

14 Immunity to Electrostatic Discharges

14.1 Instruments Used

Table 10 List of equipment used in the Immunity to Electrostatic Discharge Test

Equipment	Manufacturer	Model	Identification	Validity of calibration/verification – Traceability
SHIELDED CHAMBER	CPqD	—	CB pr-12	Calibration not required
ESD SIMULATOR	EM TEST	ESD 30 C	SNV0812103563	January 2012 – CPqD

Not valid as a compliance certificate.
This report can only be reproduced in its entirety.

14.2 Test Procedure

Procedures comply with the IEC 61000-4-2 standard, and severity levels are 6 kV for contact discharge and 8 kV for air discharge.

14.3 Environmental Conditions

All tests were performed in a controlled environment as specified in the documents listed in Section 5.

Temperature	Initial: 23.3°C	Relative air humidity	Initial: 59.8 %
	Final: 24.1 °C		Final: 58.0 %

14.4 Results

Note: Changes in the sample, if applicable, will be described in Section 2.1. Changes are designated by the sample number followed by the word “modified” and a number (in sequence). The customer is responsible for all changes.

Table 11 Immunity to Electrostatic Discharge Test Results

Default Configuration – Sample 5284			
HCP – Horizontal Coupling Plane			
EUT side	Photo	10 discharges of +6 kV	10 discharges of -6 kV
		Note	Note
Front side	Photo 20	Nothing on record	Nothing on record
Right side	Photo 21	Nothing on record	Nothing on record
Rear side	Photo 22	Nothing on record	Nothing on record
Left side	Photo 23	Nothing on record	Nothing on record
VCP – Vertical Coupling Plane			
EUT side	Photo	10 discharges of +6 kV	10 discharges of -6 kV
		Note	Note
Left side	Photo 20	Nothing on record	Nothing on record
Front side	Photo 21	Nothing on record	Nothing on record
Right side	Photo 22	Nothing on record	Nothing on record
Rear side	Photo 23	Nothing on record	Nothing on record
Air Discharge (applied only on non-conductive parts)			
Photo + Application point		10 discharges of +8 kV	10 discharges of -8 kV
		Note	Note
Photo 24 – point 1.		Nothing on record	Nothing on record
Direct Contact Discharge (applied only on conductive parts)			
Photo + Application point		10 discharges of +6 kV	10 discharges of -6 kV
		Note	Note
Photo 25 – point 2.		Nothing on record	Nothing on record

Based on the performance criteria established in the IEC 61000-4-2 standard, the EUT performance was monitored while applying the disturbance and no difference was detected when comparing both with and without disturbance operation modes.

Not valid as a compliance certificate.
This report can only be reproduced in its entirety.



Photo 20 Horizontal front view and vertical left view of EUT



Photo 21 Horizontal right view and vertical front view of EUT

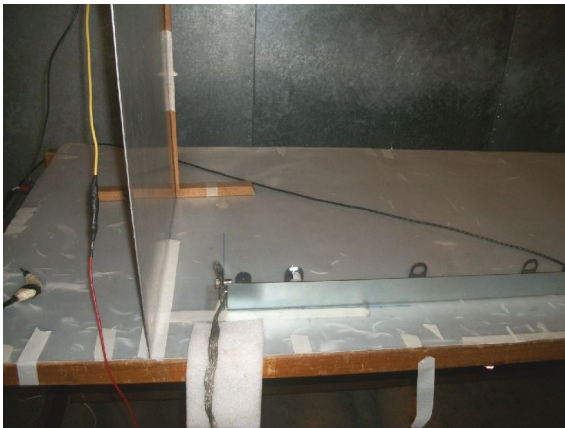


Photo 22 Horizontal rear view and vertical right view of EUT



Photo 23 Horizontal left view and vertical rear view of EUT



Photo 24 Upper view of EUT



Photo 25 Lower view of EUT

Not valid as a compliance certificate.
This report can only be reproduced in its entirety.

15 Surge Immunity in Electric Power Terminals

15.1 Instruments Used

Table 12 List of equipment used in the Surge Immunity Test

Equipment	Manufacturer	Model	Identification	Validity of calibration/verification – Traceability
SHIELDED CHAMBER	CPqD	—	CB pr-12	Calibration not required
TRANSIENTS GENERATOR	EM TEST	UCS 500 M4	CPqD 035569	October 2012 – CPqD

15.2 Test Procedure

Procedures comply with the IEC 61000-4-5 standard, with 1 kV severity level line-to-ground for telecom terminals, and 2 kV line-to-ground for electric power terminals.

15.3 Environmental Conditions

All tests were performed in a controlled environment as specified in the documents listed in Section 5.

Temperature	Initial: 25.1 °C	Relative air humidity	Initial: 48.9 %
	Final: 23.3 °C		Final: 44.8 %

15.4 Results

Note: Changes in the sample, if applicable, will be described in Section 2.1. Changes are designated by the sample number followed by the word “modified” and a number (in sequence). The customer is responsible for all changes.

Table 13 Surge Immunity Test Results

Coupling	Sample: 5284 Configuration / Cable	Note
L1-N @ ± 1kV/1,2/50µs	Default / Power Supply	Nothing on record
L1-PE @ ± 2kV/1,2/50µs	Default / Power Supply	Nothing on record
N-PE @ ± 2kV/1,2/50µs	Default / Power Supply	Nothing on record

Based on the performance criteria established in the IEC 61000-4-5 standard, the EUT performance was monitored while applying the disturbance and no difference was detected when comparing both with and without disturbance operation modes.

Not valid as a compliance certificate.
This report can only be reproduced in its entirety.

15.5 Photos of the Test Assembly



Photos 26 and 27 - Surge Immunity

16 Immunity to Magnetic Fields

16.1 Instruments Used

Table 14 List of equipment used in the Immunity to Magnetic Fields Test

Equipment	Manufacturer	Model	Identification	Validity of calibration/verification – Traceability
SHIELDED CHAMBER	CPqD	—	CB pr-12	Calibration not required
TRANSIENTS GENERATOR	EM TEST	UCS 500 M4	CPqD 035569	October 2012 – CPqD
VARIAC	EM TEST	MV 2616	SN V0812103559	October 2012 – CPqD
THREE-PHASE CDN	EM TEST	CNI 503 A2	SN V0812103558	October 2012 – CPqD
ANTENNA	EM TEST	MS100	SN 0308-19	October 2012 – CPqD
TRAFO	EM TEST	MS2630	—	October 2012 – CPqD
TRAFO	EM TEST	MS26100	SN 1207-21	October 2012 – CPqD

16.2 Test Procedure

Procedures comply with the IEC 61000-4-8 standard and the severity levels indicated next:

Level	Continuous Mode		Short Duration	
	Intensity (A/m)	Duration (min)	Intensity (A/m)	Duration (seconds)
4	30	10	Not applicable	Not applicable

Not valid as a compliance certificate.
This report can only be reproduced in its entirety.

16.3 Environmental Conditions

All tests were performed in a controlled environment as specified in the documents listed in Section 5.

Temperature	Initial: 23.1 °C	Relative air humidity	Initial: 46.9 %
	Final: 23.4 °C		Final: 45.3 %

16.4 Results

Note: Changes in the sample, if applicable, will be described in Section 2.1. Changes are designated by the sample number followed by the word “modified” and a number (in sequence). The customer is responsible for all changes.

Table 15 Voltage Dips, Short Interruptions and Voltage Variations Immunity Tests

Severity	Mode	Sample: 5284 Configuration / Nominal Voltage	Note
4	Continuous Horizontal	Default / 127 Vac @ 60Hz	Nothing on record
4	Continuous Vertical	Default / 127 Vac @ 60Hz	Nothing on record

Based on the performance criteria established in the IEC 61000-4-8 standard, the EUT performance was checked during the test, and no difference was detected when comparing both with and without disturbance operation modes.

16.5 Photos of the Test Assembly



Photos 28 and 29 - Immunity to Magnetic Fields

Not valid as a compliance certificate.
This report can only be reproduced in its entirety.

17 Immunity Test Measurement Uncertainty

In the immunity tests, the measurement uncertainty of the test method is not applicable. The uncertainty, in such cases, is related to the calibration of disturbance generators. CPqD makes sure calibration uncertainty of all instruments used during the tests is registered and updated. If necessary, the customer can formally request such record.

18 Comments

The test results refer only to the sample described in this report.

19 Document Issues

Issue date	Version Number	Description of changes
25/Nov/11	AA	First version

20 Execution and Approval

Executed by: Paulo Henrique Sigrist Givanildo Pereira de Paula Diego Jordani Soares
Approved by: <u>This document was digitally signed by:</u> Carlos Eric de Souza Ferraz Laboratory Technician Network Infrastructure Solutions Department

Date of issue: 25/Nov/11

Not valid as a compliance certificate.
This report can only be reproduced in its entirety.